
Outpatient Health Care Usability Profile vZ3

(M-OHCUP)

Date: ___/___/20__

Contact: _____

Clinic: _____

Contact Phone:(__) ___ - _____

Location: _____

Contact Email: _____

Reviewer: _____

Start Time: _____

End Time: _____

Total Time (Start-End)

Notes: _____


Section 1: Patient Arrival

Parking- applies only to parking area


1. The required number of designated parking spaces displaying the symbol shown to the right is provided (see Appendix A).
- Yes
 No
 N/A



2. At least one in every eight designated parking spaces is van accessible.
- Yes
 No
 N/A



3. There are 98 inches of vertical clearance available for lift-equipped vans
- Yes
 No
 N/A



4. All designated parking spaces are on the shortest route of travel to the building's accessible entrance.
- Yes
 No
 N/A


You may have to ask what the clinic considers their "accessible" entrance.

5. Access aisle surfaces between designated spaces are firm, stable and slip resistant.

- Yes
- No
- N/A

6. In designated passenger loading zones, there is an access aisle at least 5 feet wide and 20 feet long adjacent and parallel to a vehicle pull-up space.

- Yes
- No
- N/A

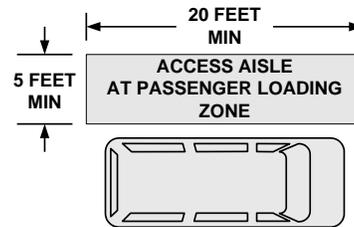

May be marked "Patient Drop-Off" or with signs or painted stripes. If no identifiable zone, then mark "N/A."

7. Curb ramps in the parking area have a smooth transition from the ramp to the passageway.

- Yes
- No
- N/A

Approach to Building- applies from parking area to entrance of building

1. The route of travel does not require the use of stairs.


- Yes
 - No
 - N/A
-

2. The surface of the route of travel is stable, firm and slip-resistant.

- Yes
- No
- N/A

3. The route leading to the building is at least 36 unobstructed inches wide.

- Yes
- No
- N/A



4. All curbs on the route of travel have curb ramps.

- Yes
- No
- N/A

If no curbs, then write "N/A."
Ramp should have/be: Slope < 1:12 (measured at steepest pt.), stable, firm, and slip resistant, 36 inches wide exclusive of flared sides. If ramp does not meet these criteria, mark "No."

5. Where there are stairs at the main entrance, there is either a ramp, lift, or an alternative entrance provided.

- Yes
- No
- N/A

6. When alternative entrances are used, there is a sign at the main entrance indicating the location of the alternative entrance.

- Yes
- No
- N/A




7. Alternative entrances can be used without assistance.

- Yes
- No
- N/A


8. The entrance door has at least 32 inches clear opening (for a double door, at least one leaf with a 32 inch clear opening).

- Yes
- No
- N/A



9. There is at least 18 inches of clear, unobstructed wall space.


- Yes
- No
- N/A

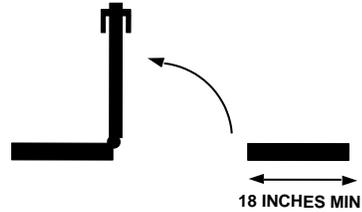

If the door is automatic, mark N/A.

10. All threshold edges are 1/4 inch high or less, or if beveled edge no more than 1/2 inch high.

- Yes
- No
- N/A

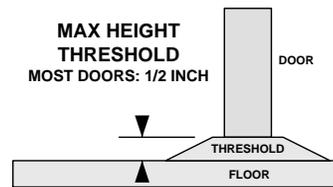

Ramps (where they exist along the path of travel)

1. The slope of a ramp (rise over run) should be no greater than 1:12.

- Yes
- No
- N/A



2. The surface of the ramp is stable, firm and slip resistant.


- Yes
- No
- N/A

3. The unobstructed width of the ramp is 36 inches.

- Yes
- No
- N/A


4. Any ramp that rises more than 6 inches or is longer than 72 inches has handrails on both sides.

- Yes
- No
- N/A




5. The top of the handrail is between 34 and 38 inches above the ramp surface.

- Yes
- No
- N/A



6. When the ramp changes direction, there is a level landing of at least 60 by 60 inches.

- Yes
- No
- N/A

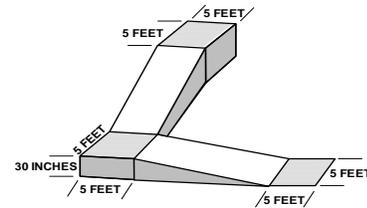

Signage (those that direct to and within a clinic only)

Section A (Questions 1-3): Measure signs along path of travel from building entrance to clinic entrance, and within clinic itself.

1. If mounted above 80 inches, characters on signs that provide directions and information have letters at least 3 inches high.

- Yes
 - No
 - N/A
-

2. If mounted above 80 inches, characters on signs that provide directions and information have high contrast.

- Yes
- No
- N/A


3. If mounted above 80 inches, characters on signs that provide directions and information have a non-glare finish.

- Yes
- No
- N/A

Section B (Questions 4-11): Measure signs within clinic only.

4. Signs designating rooms and spaces are mounted with centerlines 60 inches from floor.


- Yes
- No
- N/A



Measurement of 60 inches can be taken from anywhere on sign (top, middle, or bottom).

5. Signs designating rooms and spaces are mounted on the wall adjacent to or as close as possible to the latch side of the door.

- Yes
- No
- N/A



6. Signs designating rooms and spaces have characters and background with a non-glare finish.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
7. Signs designating rooms and spaces have raised characters.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
8. Signs designating rooms and spaces have high contrast.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
9. Signs designating rooms and spaces have Braille text.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
10. When a pictogram is used to designate rooms and spaces, it is accompanied by raised characters and Braille.	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
11. If signs designating rooms and spaces do not have raised characters, Braille, or pictograms, there is other directional assistance available (i.e. sound recordings, or a receptionist nearby).	<input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	<p>If any of the answers to Questions S1-S10 are "No" or "N/A," then answer this question. If all are "Yes," then answer "N/A."</p>

Section C (Question 12): Measure sign at clinic entrance only.

12. Sign at entrance to clinic has height of 60 inches to centerline, high contrast, raised and Braille characters, and non-glare finish.
- Yes
 No
 N/A
-


Controls (e.g. light switches, door handles)

1. All controls available to the public have controls with the highest operable part no greater than 48" and lowest operable part no lower than 15".
- Yes
 No
 N/A
- (light switches, locks, vending machines, television controls, fire alarms, etc.)
-

2. All controls that are available to the public are operable with a closed fist.
- Yes
 No
 N/A
-


Doors (within the clinic building excluding the entrance doors)

1. When a door is opened to 90 degrees, there is a clear opening width of at least 32 inches measured between the face of the door and the door stop on the latch side.
- Yes
 No
 N/A



2. Clear space between doors in a series is at least 48 inches.


- Yes
- No
- N/A

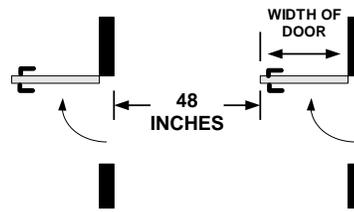

If both doors are automatic, then mark N/A

3. There is at least 18 inches of clear wall space on the pull side of doors.


- Yes
- No
- N/A



Judge doors from waiting room to exam room/ lab restroom on the path of travel only.

4. The operating hardware is mounted no higher than 48 inches above the floor.

- Yes
- No
- N/A




If door opens automatically with a sensor enter N/A.

5. All handles, locks, and latches or other opening hardware are operable with a single closed fist.

- Yes
 - No
 - N/A
-

6. All threshold edges are 1/4 inch high or less, or if beveled edge no more than 1/2 inch high.

- Yes
- No
- N/A

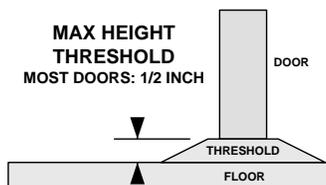


Section 2: Public Facilities

Telephones (any available for public use along path of travel)

1. The designated telephone has at least 30 by 48 inches of clear floor space.

- Yes
- No
- N/A

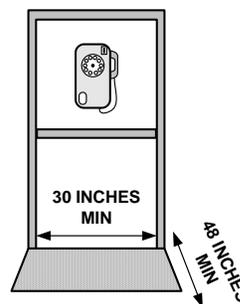


2. The route to the telephone is at least 36 unobstructed inches wide adjoining or overlapping the clear floor space.


- Yes
- No
- N/A

3. The highest operable part of the phone is no higher than 48 inches. Be sure to check coin slot height.

- Yes
- No
- N/A




4. If a wall-mounted telephone has a leading edge between 27 and 80 inches from the floor, it projects less than 4 inches into the pathway.
- Yes
 - No
 - N/A

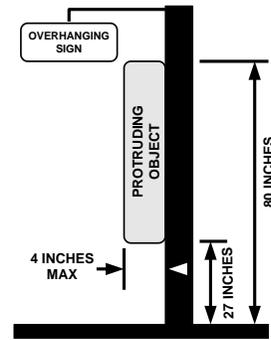

Enter "Yes" if telephone is recessed and not projecting into passageway.

6. The designated phone is adapted with volume control.
- Yes
 - No
 - N/A

Alternatively, look for volume adjustment button near keypad.

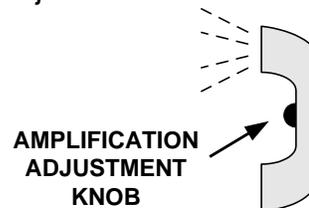

7. Volume controlled telephones are identified by a sign showing a handset radiating sound waves.
- Yes
 - No
 - N/A



8. When telephone banks (2 or more adjacent public phones) do not contain a text telephone (TTY), there is a sign to indicate location of nearest TTY.
- Yes
 - No
 - N/A




Seating (in waiting area only)

1. All aisles between seating are at least 36 unobstructed inches wide.
- Yes
 No
 N/A
-

2. There is a space for a person in a wheelchair to wait without blocking the clear width of any aisles.
- Yes
 No
 N/A
-


Counters (along the path of travel)

1. The tops of tables or counters are between 28 and 34 inches high.
- Yes
 No
 N/A
-

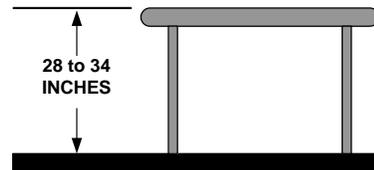

2. When tables are provided (excluding end tables) at least one has knee space of at least 27 inches high, 30 inches wide and 19 inches deep.
- Yes
 No


For example, a check-out area that has a seat for clinic personnel and a seat for patients is a table.

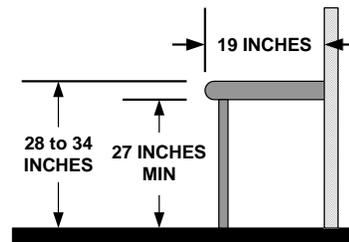

Passageways (i.e. route of travel to clinic services excluding doorways)

1. All passageways are at least 36 unobstructed inches wide.

- Yes
- No
- N/A



If temporary objects protrude into passageway, then measure passageway to edge of object.


2. If the passageway is less than 60 inches wide, there are passing spaces at least 60 inches wide and 60 inches long or intersecting walks allowing passing at reasonable intervals not exceeding 200 feet.

- Yes
- No
- N/A


If passageway is more than 60 inches wide, mark N/A.

3. There is a 5 foot circle or T-shaped space (36 inches wide each direction and 60 inches minimum depth) to reverse direction.

- Yes
- No
- N/A




Note: This is a difficult measurement to make. It may require 2 people working together to make an accurate reading. Study the diagram closely, and take your time making your measurement.

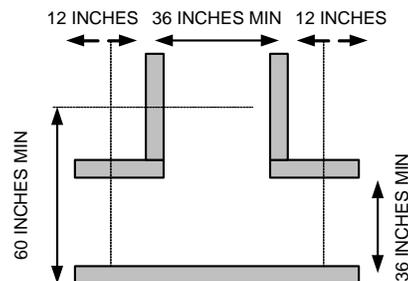


4. Where a passageway makes a U-turn around an obstacle which is less than 48 inches wide, the passageway width increases to at least 42 inches on the approaches and 48 inches in the turn.

- Yes
- No
- N/A

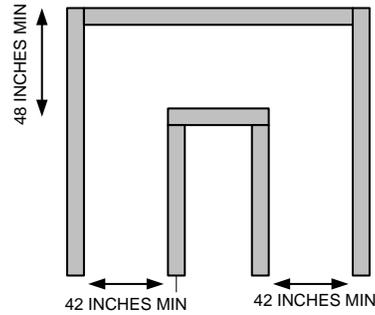


5. If passageway levels change, the vertical difference is less than 1/4 inch, or if the change in level is between 1/4 and 1/2 inch there is a beveled edge with a slope no greater than 1:2.

- Yes
- No
- N/A

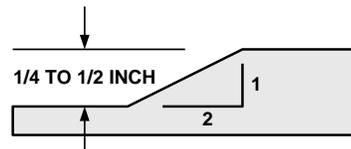

6. Objects mounted on the wall that have leading edges between 27 inches and 80 inches from the floor, project less than 4 inches into the passageway.

- Yes
- No
- N/A




7. Carpeting is low-pile, tightly woven and securely attached along edges.

- Yes
- No
- N/A

8. In passageways through public areas, all obstacles (e.g. fire extinguishers) are located within 27 inches of the floor or higher than 80 inches and protrude less than 4 inches from the wall.


- Yes
- No
- N/A



Water Fountains (where they exist along the path of travel)


1. Where fountains are provided, there is a clear floor space of at least 30 by 48 inches.

- Yes
- No
- N/A




2. When fountains are provided, there is at least one fountain with its spout fixture no higher than 36 inches from the floor.

- Yes
- No
- N/A

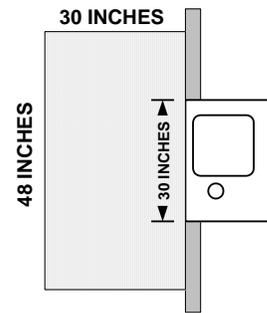

3. If a wall-mounted fountain has a leading edge between 27 and 80 inches from the floor, it projects less than 4 inches into the pathway. [Note: Many times, there is a high-low fountain arrangement. The high fountain may be a protruding object if not recessed.]

- Yes
- No
- N/A

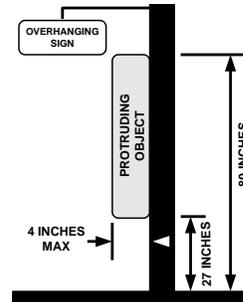

Enter "Yes" if fountain is recessed and not projecting into passageway.

Lifts (when provided along the path of travel)

1. Where a lift is provided, it is usable without assistance

Yes
 No
 N/A

2. If the lift is not usable without assistance, a call button is provided.

Yes
 No
 N/A

3. The lift controls are operable with a closed fist.

Yes
 No
 N/A

4. The lift controls are located no higher than 48 inches for a forward approach.

Yes
 No
 N/A




5. The lift controls are located no higher than 54 inches for a side approach.

Yes
 No
 N/A

6. The floor surface of the lift is slip-resistant and any change in level is less than 1/4 inch.

Yes
 No
 N/A

Elevators (where they exist along the path of travel)

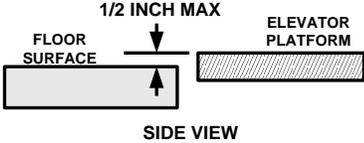- | | | |
|---|---|--|
| 1. The call button has a visual signal that indicates direction of travel. | <input type="checkbox"/> Yes
<input type="checkbox"/> No
<input type="checkbox"/> N/A |  |
| 2. The call button has an audible signal that indicates direction of travel. | <input type="checkbox"/> Yes
<input type="checkbox"/> No
<input type="checkbox"/> N/A |  |
| 3. There are signs identifying the floor in raised letters on both sides of the door jamb of the elevator at every floor. | <input type="checkbox"/> Yes
<input type="checkbox"/> No
<input type="checkbox"/> N/A | |
| 4. There are signs identifying the floor in Braille letters on both door jambs of the elevator at every floor. | <input type="checkbox"/> Yes
<input type="checkbox"/> No
<input type="checkbox"/> N/A | |
| 5. The elevator automatically comes within 1/2 inch of the floor landing at each stop. | <input type="checkbox"/> Yes
<input type="checkbox"/> No
<input type="checkbox"/> N/A |  |
-



6. The elevator is large enough that a wheelchair user can enter, reach the controls and exit.

Yes

No

N/A

Note: This is a difficult measurement to make. It may require 2 people working together to make an accurate reading. Study the diagram closely, and take your time making your measurement.

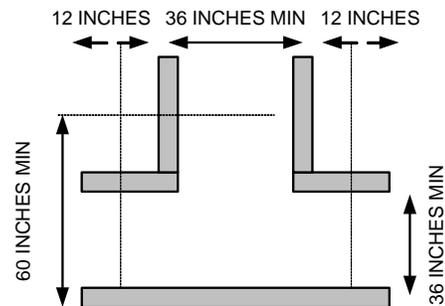


7. The elevator doors re-open automatically without contact if an object passes through the opening between 5 and 29 inches above the floor.

Yes

No

N/A



Yes

8. When re-opened, it is for **at least 20 seconds.**

No

N/A

Yes

9. The buttons inside the elevator have Braille lettering.

No

N/A

10. The buttons inside the elevator have raised lettering.


- Yes
- No
- N/A

11. If provided, the emergency communication system (e.g. handset, intercom) is identified Braille and raised letters.

- Yes
- No
- N/A


12. If provided, the emergency communication system (e.g. handset, intercom) is no higher than 48 inches above the floor.

- Yes
- No
- N/A

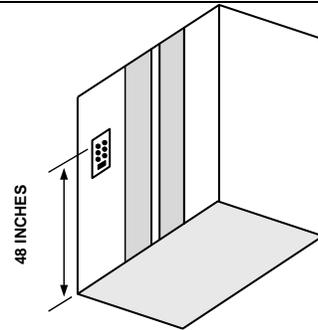

13. All elevator controls are no lower than 15 inches and no higher than 48 inches from floor.


- Yes
- No
- N/A

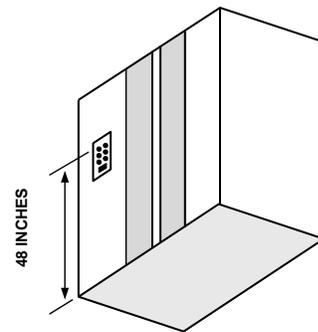

Stairs (where they exist along the path of travel)


1. Handrails have 12- inch extensions beyond the top riser.

- Yes
- No
- N/A

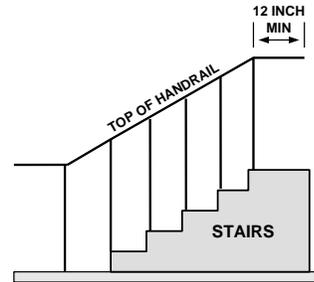


2. Handrails have 12- inch extensions beyond the bottom riser.

- Yes
- No
- N/A

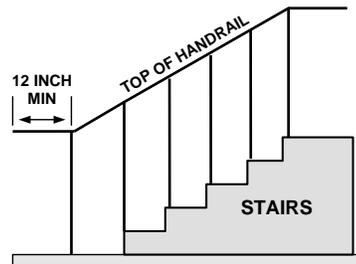

3. For stairs along the path of travel, the risers are closed.

- Yes
- No
- N/A

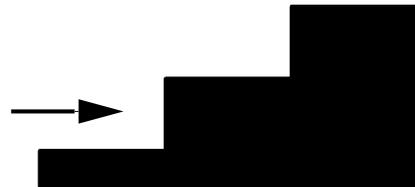

4. For stairs along the path of travel, the steps have uniform riser and tread width.

- Yes
- No
- N/A


5. If there are stairs between the elevator and primary clinic services, there is a designated route without stairs.

- Yes
 - No
 - N/A
-

Rest Rooms (lobby and waiting area only- if clinic has no restrooms available to the public, enter N/A for all items in this section)

Features for both toilet stalls and toilet rooms

1. Signs are mounted on the wall on the latch side of the door, 60 inches to the centerline (not on the door itself).
- Yes
 No
 N/A




Measurement of 60 inches can be taken from anywhere on sign (top, middle, or bottom).

-
2. Where pictograms or symbols are used to identify rest rooms, Braille characters are included below them.
- Yes
 No
 N/A

-
3. Where pictograms or symbols are used to identify rest rooms, raised characters are included below them.
- Yes
 No
 N/A

-
4. The restroom doorway is at least 32 inches wide.
- Yes
 No
 N/A

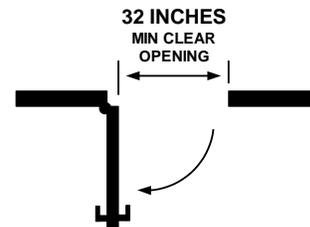

-
5. Doors are operable with a closed fist.
- Yes
 No
 N/A
-


6. Door handles are placed no higher than 48 inches.

Yes

No

Remember to check the both sides of door.

N/A





7. The entry is large enough for a wheelchair user to enter, turn around and exit.

Yes

No

Note: This is a difficult measurement to make. It may require 2 people working together to make an accurate reading. Study the diagram closely, and take your time.

N/A

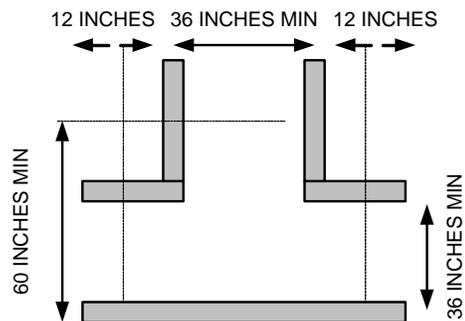

8. There is a 36-inch wide unobstructed path to all fixtures (e.g. sink, soap dispensers).

Yes

No


N/A

9. The sink has a 30-inch wide by 48-inch deep clear space in front (a maximum of 19 inches of the required depth may be under the sink).

Yes


No

N/A

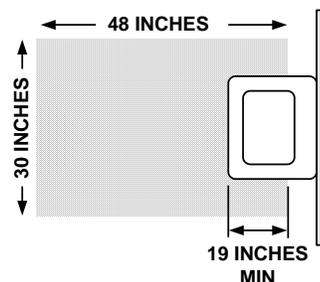


10. Pipes under the sink are covered to protect against contact.

- Yes
- No
- N/A




11. Where counters or tables are provided, the top is between 28 and 34 inches from the floor.

- Yes
- No
- N/A




12. The sink rim is no higher than 34 inches.

- Yes
- No
- N/A




13. The faucet is operable with a closed fist.

- Yes
- No
- N/A



14. The highest operable part of all dispensers and hand dryers is no higher than 48 inches a forward approach.

- Yes
- No
- N/A




15. All dispensers and hand dryers are operable with a single closed fist (pull-down paper-towel dispensers & many seat-cover dispensers are usually not accessible by this criteria).

Yes
 No
 N/A

16. The mirror is mounted with the bottom edge of the reflecting surface no higher than 40 inches.


Yes
 No
 N/A

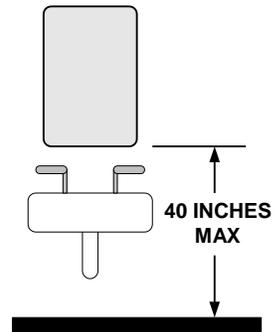

Note: This is a difficult measure to take and sometimes requires more than one measurement. Please use caution.


17. There are 2 horizontal grab bars: one on the wall behind the toilet and one on the side wall nearest to the toilet in the designated stall/toilet room.

Yes
 No
 N/A

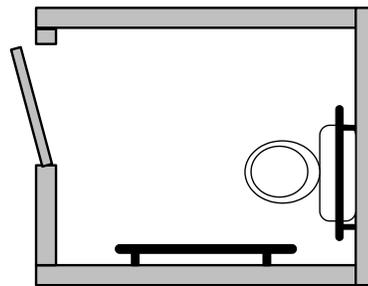

18. The toilet seat is 17" to 19" high.

Yes
 No
 N/A

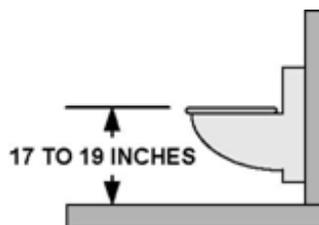

19. At all rest rooms, there is a sign indicating the location of the designated rest room(s).


- Yes
- No
- N/A



20. There is at least 18 inches of clear space from the center of the toilet to the wall(s) on either side.

- Yes
- No
- N/A

Note: Make measurement to wall. Do not include objects such as toilet paper dispensers in your measurement.

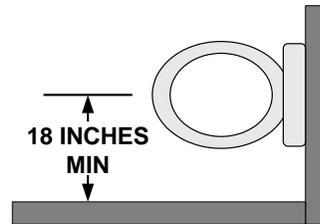


For toilet stalls

1. All stall door hardware is operable with a closed fist.

- Yes
- No
- N/A


2. When stall door is open 90 degrees, there is at least 32-inches clear width.

- Yes
- No
- N/A

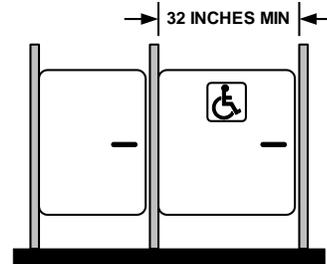


3. There is a designated stall with a clear floor space of at least 5 feet long by 5 feet wide.

- Yes
- No
- N/A

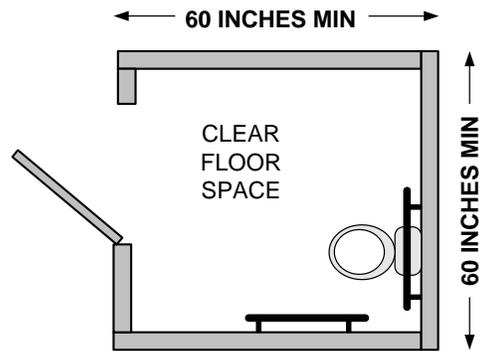


4. Where there is no stall with a clear floor space of five feet long and five feet wide there, there is a stall that either 36 by 69 inches or 48 inches by 69 inches.

- Yes
- No
- N/A

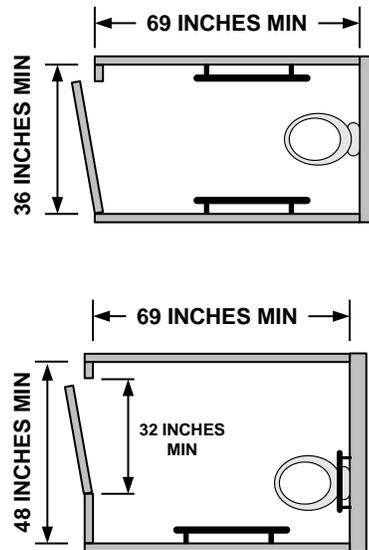

5. There is at least 18 inches of clear space at the latch side of the door.

- Yes
- No
- N/A

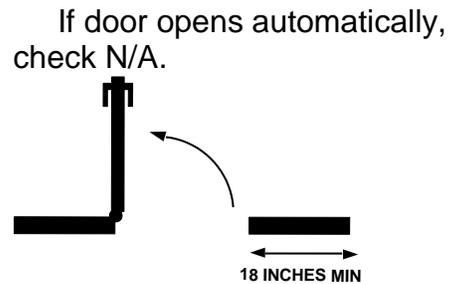


For toilet rooms

1. Where the toilet is approached from the front and there is a sink alongside the toilet, there is clear floor space of at least 48 inches wide by 66 inches long (toilet wall to opposite wall).


- Yes
- No
- N/A

If door swings inward, measure space clear of door swing. This is easiest done with 2 people.

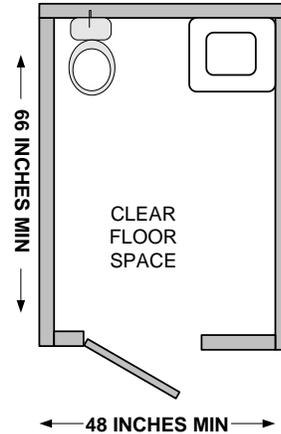


2. Where the toilet is approached from the side and there is a sink alongside the toilet, there is clear floor space of at least 48 inches wide by 56 inches long (toilet wall to opposite wall).

- Yes
- No
- N/A

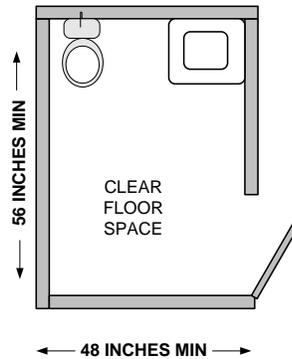

3. Where there is no sink alongside the toilet, there is a clear floor space of at least 60 inches wide by 56 inches long (toilet wall to opposite wall).

- Yes
- No
- N/A

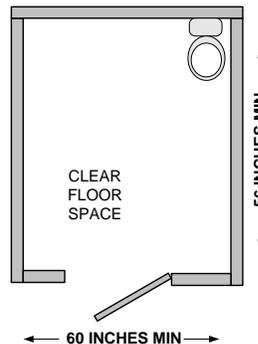

Emergency Egress (a route or path for going out in case of an emergency)

1. The emergency route is at least 36 unobstructed inches wide.

Yes
 No
 N/A


If temporary objects protrude into passageway, then measure passageway to edge of object.

2. The emergency route does not require the use of stairs.

Yes
 No
 N/A


3. Each door along the emergency route is an accessible door.

Yes
 No
 N/A




4. Where emergency alarms are provided, they have flashing lights.

Yes
 No
 N/A



5. Where emergency alarms are provided, they have audible signals.

Yes
 No
 N/A



6. Where emergency alarms are provided, additional visual alarms are installed in general use areas such as hallways, lobbies and restrooms.

Yes
 No
 N/A

7. The visual alarms are placed 80" above the highest floor level within the space or 6" below the ceiling, whichever is lower.

Yes
 No
 N/A

8. Each area of rescue assistance provides at least 2 clear spaces no smaller than 30 by 48 inches.

Yes
 No
 N/A

NOTE: Areas of rescue assistance are not required in 1-story buildings without elevators.

9. Each stairway serving an area of rescue assistance is at least 48 inches wide between handrails.

Yes
 No
 N/A

Section 3: Exam Rooms and Access to Primary Services

1. There is a loaner wheelchair available.

Yes
 No
 N/A

2. There is a 36-inch passageway (excluding doorways) from the waiting area to designated exam room.

Yes
 No
 N/A

3. There is a method to weigh a wheelchair-user.

- Yes
 - No
 - N/A
-

4. There are graphic charts for assessing pain for patients with cognitive disabilities.

- Yes
 - No
 - N/A
-

5. There is at least one lift or transfer device in exam room.

- Yes
 - No
 - N/A
-

Accessible Exam Table [Material in this section excerpted from the **2008 Massachusetts Facility Assessment Tool (MFAT)**, which compiles standards from the Americans with Disabilities Act of 1990 (ADA), the Massachusetts Architectural Access Board codes, and other Massachusetts Department of Public Health requirements.]

1. There is at least one exam table that is adjustable to 18" or less" measured from the top surface of the table to the floor.

- Yes
 No
 N/A

Yes

2. The table is able to support body weight of 300 pounds or more.

- No
 N/A

Yes

3. The table has an automatic adjustable backrest that can be adjusted to any desired position.

- No
 N/A

Yes

4. The table has either leg holders or gynecological stirrups as foot attachments.

- No
 N/A

Yes

5. The table has foot and leg supports that are adjustable for a variety of range extremities.

- No
 N/A

Yes

6. The table has foot and leg supports that have cushioning and straps.

- No
 N/A
-

Yes

7. The table can accommodate different leg lengths. No

N/A

Yes

8. The table can accommodate different abilities to flex & extend /open & close legs. No

N/A

Yes

9. Is there at least 1 accessible exam table in an accessible exam room? No

N/A

Accessible Dressing Room [Material in this section excerpted from the **2008 Massachusetts Facility Assessment Tool (MFAT)**, which compiles standards from the Americans with Disabilities Act of 1990 (ADA), the Massachusetts Architectural Access Board codes, and other Massachusetts Department of Public Health requirements.]

Yes


1. The accessible room is located on an accessible route. No

N/A

2. When access is swinging or sliding door or curtain, it has a T-shaped clear floor space or one that is 60" in diameter for a wheelchair to make a 180° turn. Yes

No

N/A

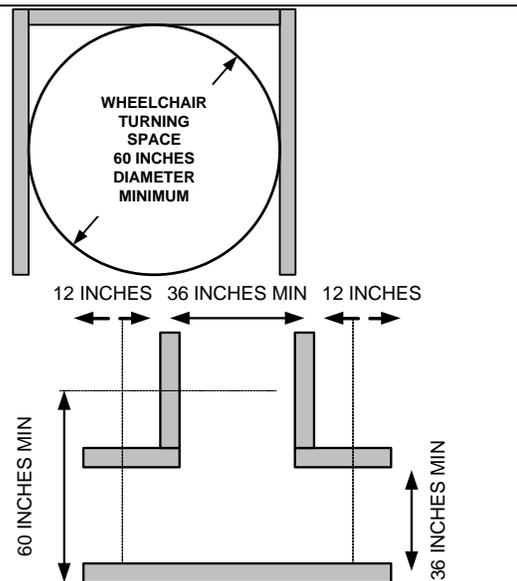

3. Dressing room has a mirror at least 18" wide, 54" high, mounted at least 18" above the floor in a position to afford a view when standing or sitting on the seat/bench.

Yes

No

N/A

4. Room has a coat hook located a maximum of 48" above the floor.

Yes

No

N/A

5. Bench is at least 48" wide.

Yes

No

N/A

6. Bench is 18" high.

Yes

No

N/A

7. Bench is at least 24" deep.

Yes

No

N/A

Accessible Mammography Machine [Material in this section excerpted from the **2008 Massachusetts Facility Assessment Tool (MFAT)**, which compiles standards from the Americans with Disabilities Act of 1990 (ADA), the Massachusetts Architectural Access Board codes, and other Massachusetts Department of Public Health requirements.]

1. The mammography machine is on an accessible route.

Yes

No

N/A

2. The machine has a positioning chair with a braking device and adjustable arms available for ready access.

Yes
 No
 N/A


3. The machine has a breast platform that lowers to a height of 24"-27" above the floor to the top side of the platform.

Yes
 No
 N/A

(NOTE EXCEPTION TO MFAT: This question varies the height requirement from the original MFAT standard of 24".)

4. The machine has a 60" diameter circle of clear floor space or a T-shaped clear floor space as shown adjacent to the machine?

Yes
 No
 N/A

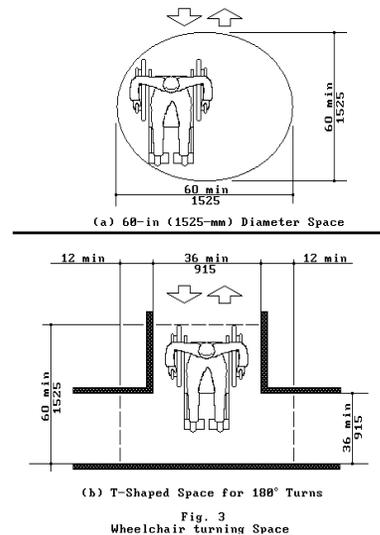

5. Does at least one mammography machine meet ALL of the above standards?

Yes
 No
 N/A

Appendix A – Parking Requirements

Total Parking Spaces:	Required Minimum Number of Spaces:
1 to 25	1
26 to 50	2
51 to 75	3
76 to 100	4
101 to 150	5
151 to 200	6
201 to 300	7
301 to 400	8
401 to 500	9
501 to 1000	2% of total
1001 and over	20 plus 1 for each 100 over 1000

Number of required parking spaces for outpatient units and facilities: 10 percent of the total number of parking spaces provided serving each such outpatient unit or facility.